TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION

EU - TYPE EXAMINATION CERTIFICATE

2014/32/EU Measuring Instruments Directive

1783-MID-053

In accordance with Measuring Instruments Directive dated February 26, 2014 and numbered 2014/32/EU of the European Union Parliament and "Ölçü Aletleri Yönetmeliği (Measuring Instruments Directive)" numbered 2014/32/AB which was published in Official Journal of Turkish Republic dated 29.06.2016 and numbered 29757:

Manufacturer : **BAYLAN ÖLÇÜ ALETLERİ SANAYİ VE TİCARET LTD. ŞTİ.**

Atatürk Organize San. Böl. 10032. Sokak No:16 Çiğli / İZMİR

Essential requirements Applied : **MID Annex I and Annex MI-003**

Name of Measuring : **Three-Phase Active Electrical Energy Meter**

Type : **BTK.30**

Environmental Classes

- Climatic	**-40 °C / +70 °C**
- Mechanic	**M1**
- Electromagnetic	**E2**

Project Number : **1839-18/384807**

Comformity Assessment Report : **1839-MID-053/2018-01**

Date of issue : **24.05.2019 (First Issue: 09.11.2018)**

Valid until : **09.11.2028**

Total Page Number : **15**

Sezai DOĞAN
Director of Directives
Ankara 24.05.2019 Rev 02

TÜRK STANDARTLARI ENSTİTÜSÜ · DİREKTİFLER MÜDÜRLÜĞÜ · TURKISH STANDARDS INSTITUTION · DIRECTORATE OF DIRECTIVES · CE 1783 TSE

This certificate is only valid with annex and TSE-Notified Body 1783 seal.

www.tse.org.tr / Necatibey Cad. No: 112 Bakanlıklar - ANKARA / +90 312 416 62 00
Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or ereased for misunderstanding.

1. General Information about Electical Energy Meter

1.1 Designation

Electronical electric meter measuring active electrical energy and maximum power and showing these data on the LCD Display, auto-correcting day light saving time in summer and winter, keeping the intended data and programs in memory, getting a line on these data when required.

1.2 Design

Essential Parts of the Meter

- Electronic (circuit) card
- Lower cover-housing
- Upper cover
- Terminal cover

1.3 Metrological Characteristic

Measurement of the electrical energy

1.4 Software

Ver 1.00

1.5 Supplementary equipments

RS485 communication port

1.6 Equipments out of the scope of MID

Reactive energy measurement

According to the relevant test reports, Active and reactive measurement of the meter work properly and together. Yet, reactive part of meter is out of scope of MID (2014/32/EU) and this certificate.

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazınıp ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or creased for misunderstanding.

2. Technical data

Type	BTK.30
Definition	3 phases, 4 wired, multi tariff, with demand meter, outdoor, active, import&export electronic electrical meter
Accuracy Class	Active Class C
Software Version No **Checksum** **Place**	Ver 1.00 0x17A22C92 İzmir
Meter Location	Outdoor
Meter Integrity	Meter integrity is preserved by seal and intervention from the outside is inhibited
Sealing Type	Plastic Pounding Seal
Temperature Interval	-40 °C / +70 °C
Circuit Type	Directly connected
Frequency	50 Hz
Reference Voltage (V)	3 x 230 V / 400 V
Operating Voltage (V)	Between 0,8Un and 1,15Un
Starting Current (Ist)	20 mA (0,04Itr)
Minimum Current (Imin)	0,15 A
Transitional Current (Itr)	0,5 A
Reference Current (Iref)	5 A
Maximum Current (Imax)	100 A
Meter Constant	1000 imp/kWh 1000 imp/kVarh ind. 1000 imp/kVarh kap.
Operating Temperature	-40°C …+70°C (3K7)
Relative Humidity	Max. %95
IP Rating	IP54 (Outdoor)
Protection Class	II (Two)
Mechanical Environment Class	M1
Electromagnetic Environment Class	E2
Voltage Circuit Power Consumption	< 2W, 10 VA
Current Circuit Power Consumption	< 4 VA
Electrostatic Discharges	Contact: 8 kV Air: 15 kV
Impulse Voltage	6 kV
Communication	Optik, RS485 300-19200 Baud

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or creased for misunderstanding.

3. Marking

The following data shall be marked on the electricity meter

- manufacturer's name and/or registered trademark,
- phase number and connection cable number
- year of production and serial number,
- current gauging interval, minimum current (Imin), reference current (Iref), maximum current (Imax)
- reference frequency (Hz),
- meter constant
- accurancy class
- electric security class (double square mark for meters with insulating lining)
- operating temperature interval or environmental class
- nominal voltage (primary and secondary voltage if with transformer),
- EU-Type examination certificate number,
- conformity marking according to the regulation in regards to the measuring intruments

3.1 Registered trademark of the manufacturer

The manufacturer uses the following figure inscription commercial trademark on the electrical energy meters

BAYLAN

4. Sealing

Lower housing of the meter and upper cover are screwed together and it is stamped by attaching a plastic seal on the gap above the screw. Terminal cover is sealed by authorised personnel after the meter has been mounted.

5. Terms of Production, putting into use and usage

5.1 Production

- no special terms identified for production

5.2 Putting into use

- electrical energy meters must be installed in the power grid as mentioned in installation instructions and/or user's manual of the manufacturer.
- type tests of the meter were carried out according to EN 50470-1:2006 and EN 50470-3:2006

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or creased for misunderstanding.

5.3 Requirements for usage

- must be used in accordance with the terms of the user's manual given by the manufacturer.

6. Documentation used within the scope of assessment

- Test report dated 10.10.2018 and 318101001 issued by Baylan Ölçü Aletleri San. ve Tic. Ltd. Şti.
- Testing report dated 05.11.2018 and EL18-0044 issued by Eldaş Elektrik, Elektronik San. ve Tic. A.Ş.
- Manufacturer's technical file, technical drawings, component lists

7. Standards and regulations used within the scope of assessment

7.1 Regulations, harmonised standards and mandatory normative documents

- Measuring Instruments Directive numbered 2014/32/AB published in the Official Journal dated 29.06.2016 and number 29757
- EN 50470-1:2007
- EN 50470-3:2007
- OIML R 46:2012

7.2 Reference documents

- WELMEC Guide 7.2

8. Conclusion

Structural, technical and metrological parameters of the meter must be compatible with the documentation submitted with this Type Examination Certificate. The meter must meet the requirements of the Measuring Instruments Directive numbered 2014/32/EU of the European Union Parliament and the Council and the Measuring Instruments Directive numbered 2014/32/AB published in the Official Journal dated 29.06.2016 and number 29757 of Turkish Republic.

9. Annexes

Annex-1: Illustrative pictures of the electricity meter

Annex-2: Demonstration of Sealing

Annex-3: Marking

Annex 4: Meter Dimensions

Revision Page

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or creased for misunderstanding.

Annex-1:

Front Picture of Meter

Closed body

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or ereased for misunderstanding.

Transparent body

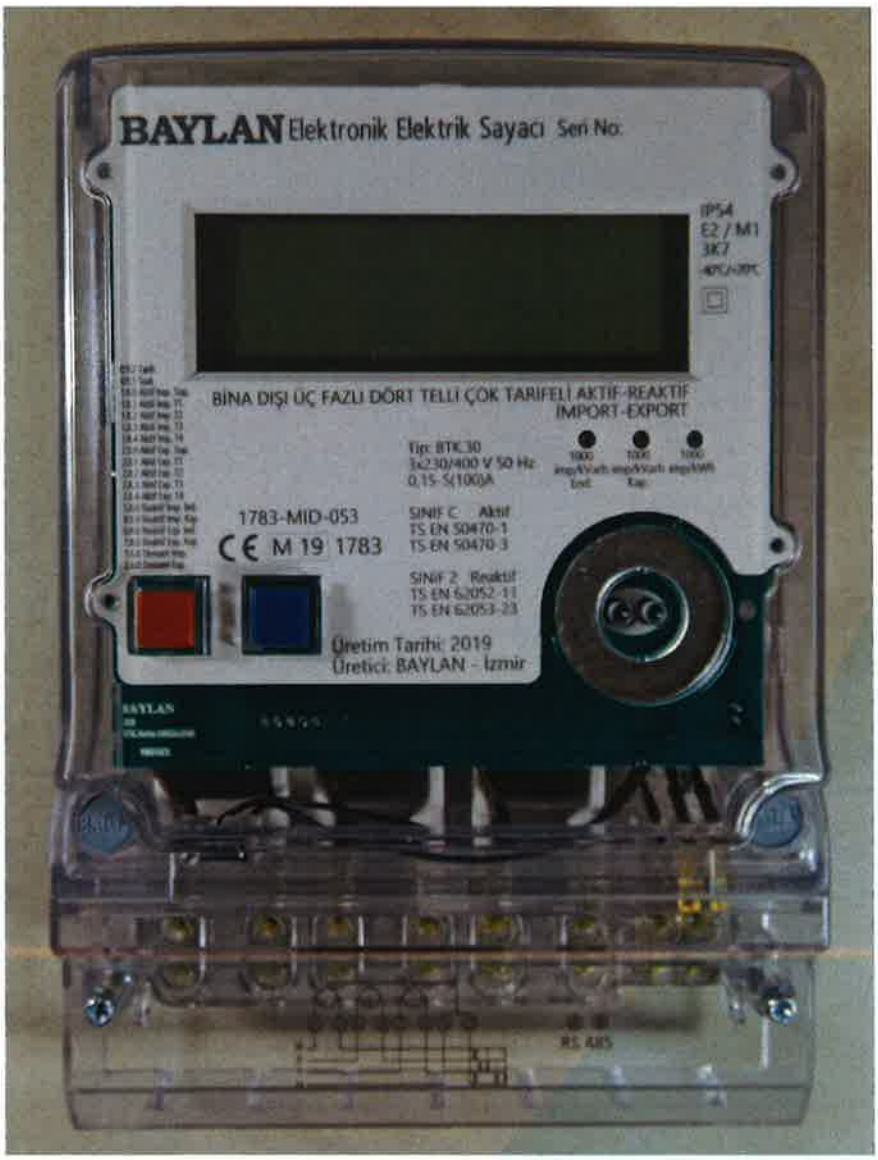

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or creased for misunderstanding.

Back Picture of Meter

Closed body

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or ereased for misunderstanding.

Transparent body

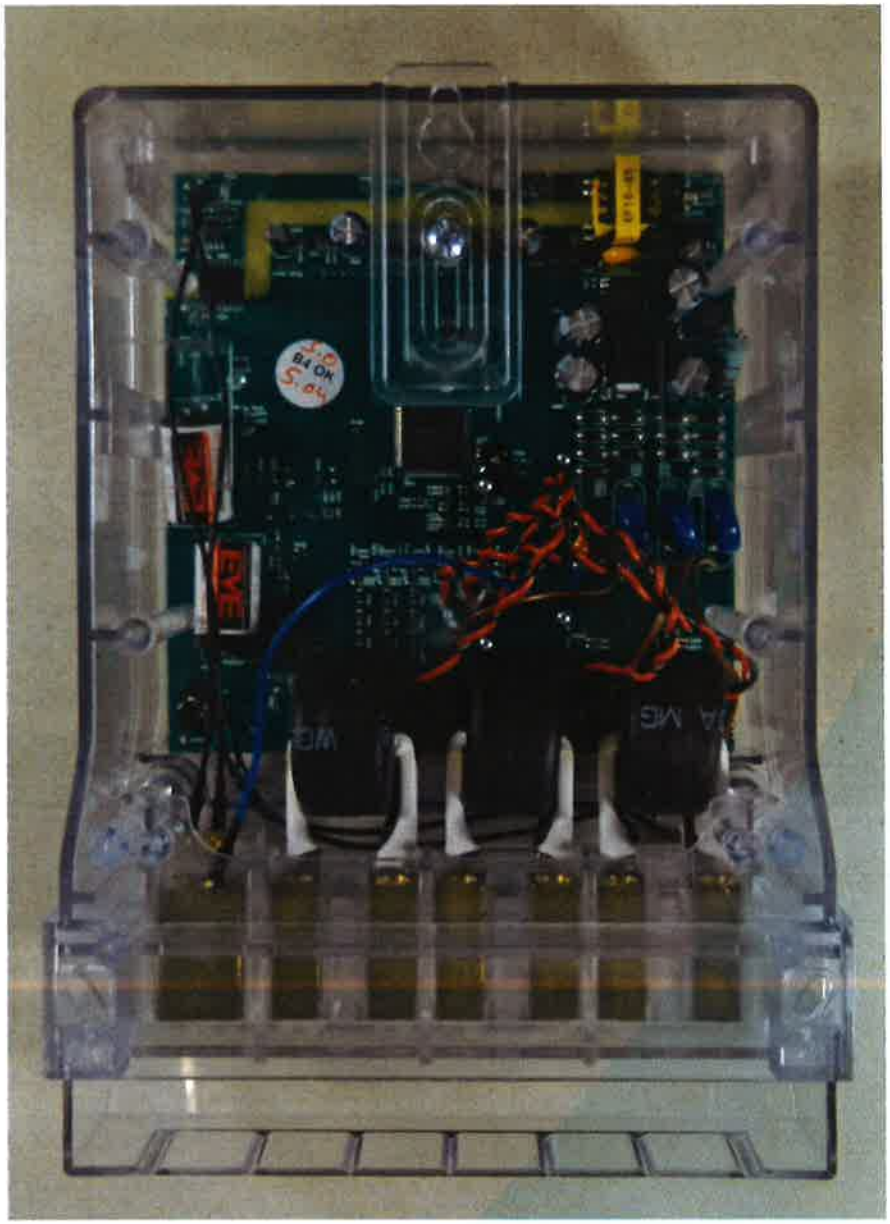

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or creased for misunderstanding.

Right View Picture Of Meter

Closed body

Transparent body

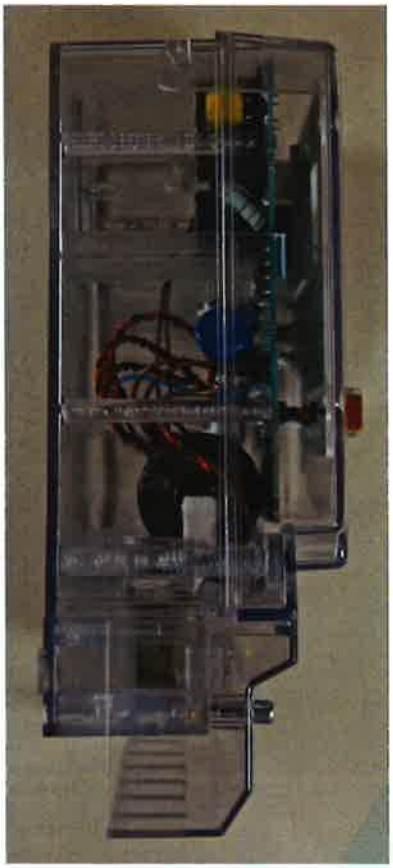

Inside view of the Meter

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or ereased for misunderstanding.

Electronic Card Front View

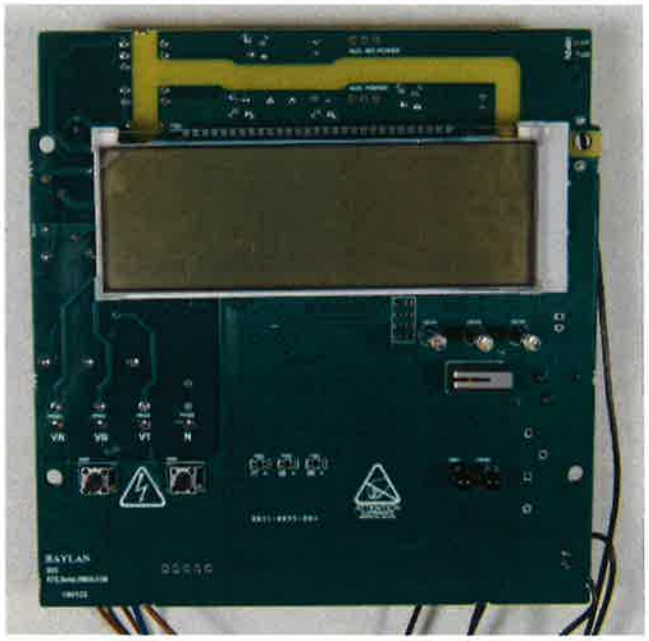

Electronic Card Back View

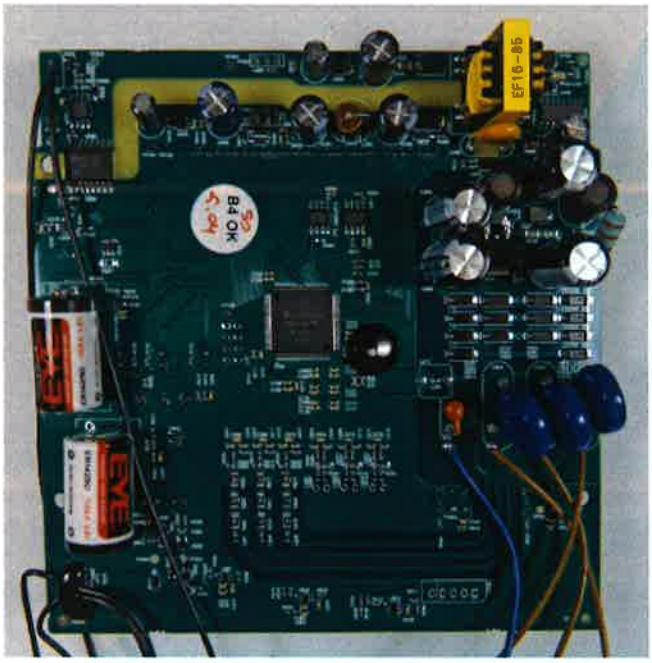

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or creased for misunderstanding.

Annex-2:

Sealing

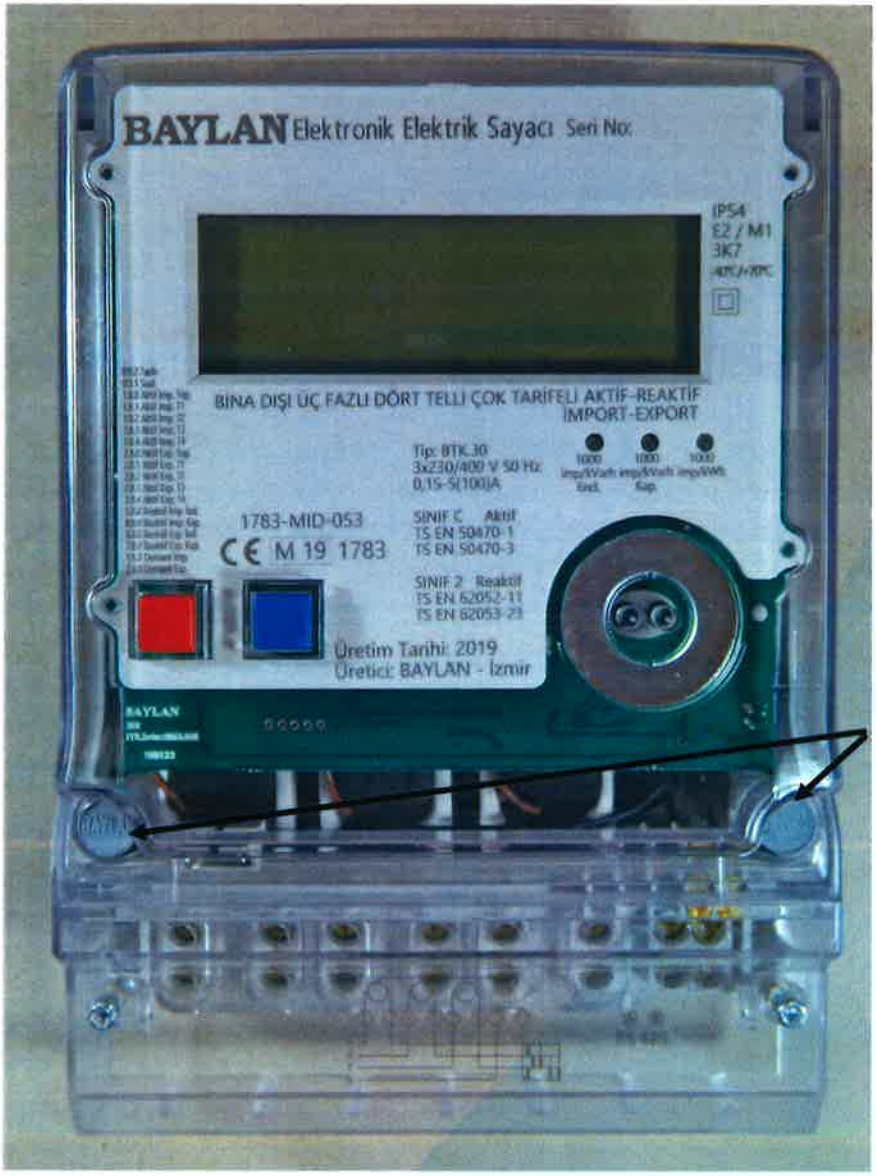

www.tse.org.tr / Necatibey Cad. No: 112 Bakanlıklar - ANKARA / +90 312 416 62 00
Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or ereased for misunderstanding.

Annex 3 :

Marking

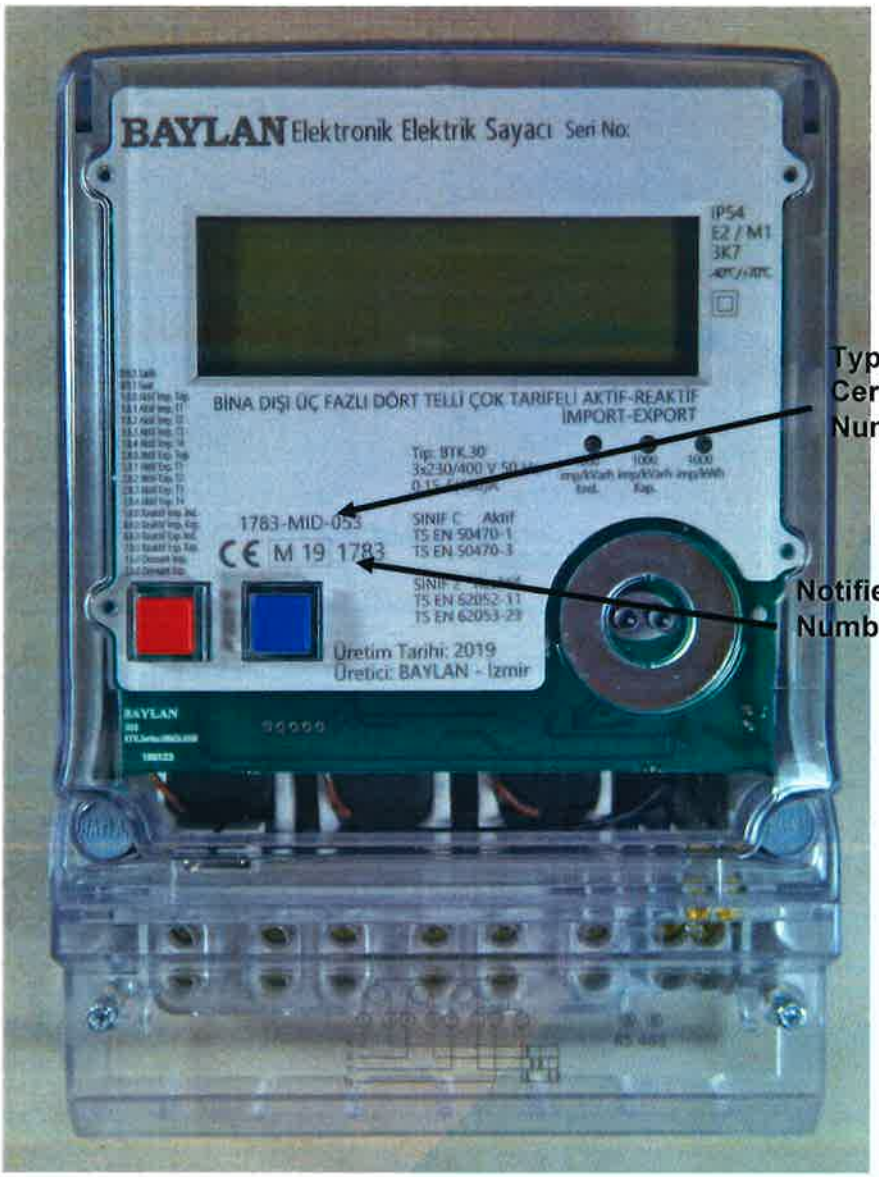

www.tse.org.tr / Necatibey Cad. No: 112 Bakanlıklar - ANKARA / +90 312 416 62 00
Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or ereased for misunderstanding.

Annex 4 :

Meter Dimensions

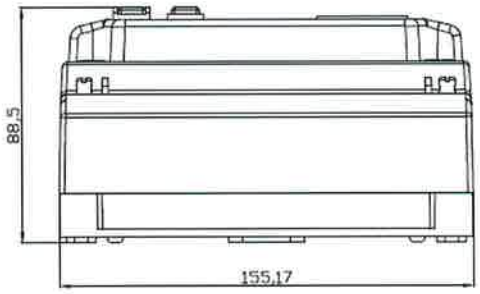

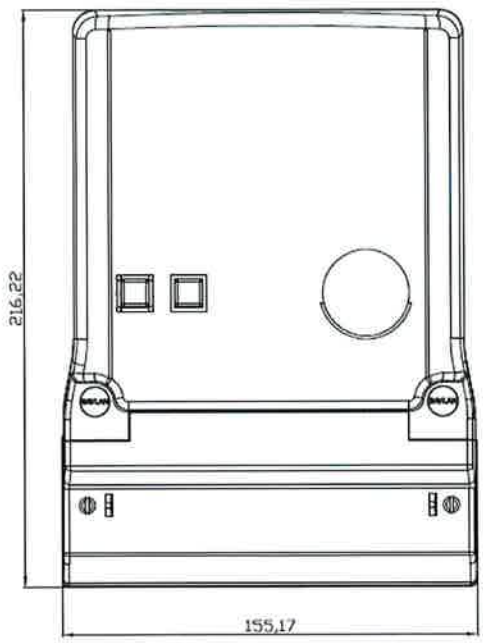

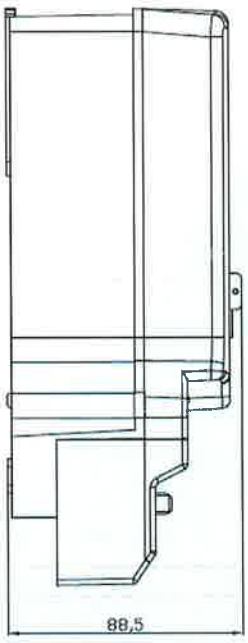

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or creased for misunderstanding.

REVISION PAGE

Rev. No.	Date	Revision Reason
-	09.11.2018	First Issue
01	24.01.2019	Editorial Changes
02	24.05.2019	Alternative Body Type added

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially dublicated or ereased for misunderstanding.